



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**De La Fontaine
Inswing Single Glazed Steel Door
(HVHZ)(Impact)**

for

Florida Product Approval

FL# FL46851

Report No. 9318

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Inswing Single Glazed Steel Door
Materials:	18 Ga. Min. Cold Rolled Steel
Product Dimensions:	See Installation Instructions, DLF005

Prepared for:

**De La Fontaine
4115 Brodeur Street
Sherbrooke, QC J1L1K4**

Prepared by:

Hermes F. Norero


Florida Professional Engineer # 73778

Date: 6/21/2024

Contents:

Evaluation Report Pages 1 – 3

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2024.06.25 11:54:34 -04'00'

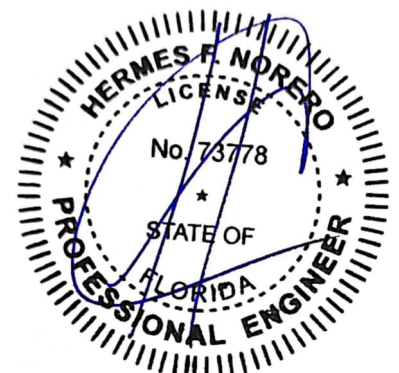

Hermes F. Norero, P.E.
Florida P.E. No. 73778

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: De La Fontaine

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method 1(d)

Product Name: Inswing Single Glazed Steel Door
(HVHZ)(Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **De La Fontaine** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the Florida Building Code.

See Installation Instructions **DLF005**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the Florida Building Code and **does not require** an impact resistant covering.
4. Site conditions that deviate from the details of Installation Instructions **DLF005** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **DLF005** for size and design pressure limitations.

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Quality Assurance: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Intertek Testing Services NA, Inc. - QA Entity**. (FBC Organization #: QUA1673)

Performance Standards: The product described herein has been tested per:

- TAS 201-94
- TAS 202-94
- TAS 203-94
- ASTM E283-04(12)
- ASTM E330-14(21)
- ASTM E1886-19
- ASTM E1996-17

Referenced Data:

1. Product Testing performed by **QAI Laboratories**
(FBC Organization # TST1657)
Report #: MED-1233a, Report Date: 05/23/24
All reports signed and sealed by Idalmis Ortega, FL P.E. No 76905
2. Quality Assurance
Intertek Testing Services NA, Inc. - QA Entity
(FBC Organization # QUA1673)
3. Material Certification
Miami-Dade County Notice of Acceptance
Kuraray America, Inc.
SentryGlas Interlayer

Installation: Refer to Installation Instructions (**DLF005**) for qualified installation methods and requirements.

Design Pressure: Refer to Installation Instructions (**DLF005**) for design pressures dependent on hardware type, configuration, and size of units.